

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 1032

Dated: 18/05/2026

It is certified that an inspection team headed by Ranjodh Singh J.E (Name of Officers with Designation) from Water Supply and Sanitation (Name of Department/ Office) inspected the AKAL ACADEMY THEH KALANDHAR, Post Office Behak Khas, District Fazilka, Pin Code 152123 (Name & Address of the school) on 30-03-2026 (date of inspection) and found that the AKAL ACADEMY THEH KALANDHAR (Name of School) has safe drinking Facilities for students and staff of the institution and is maintaining hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State / U.T. Govt.

The above is valid for a period of.....1 Year..


Signature with Seal:

Sub Divisional Engineer
Water Supply & Sanitation
Sub Division No. 1, Fazilka

Name : Abhijeet Singh
Designation : Sub Division Engineer

Name & Address of the Office / Department

Water Supply and Sanitation,
Sub Division No. 1, Fazilka, I.T.I,
Near Malout Chownk, Fazilka

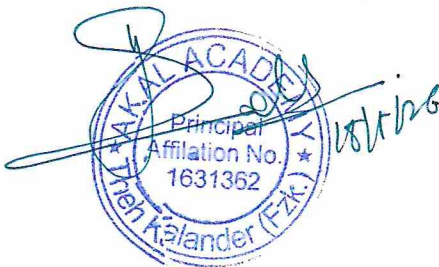

To
Principal,
Akal Academy Theh Kalandhar,
Post Office: Behak Khas,
Tehsil- Fazilka, 152123, PB

(Name & Address of the Institution)

Manager
Akal Academy
Theh Kalandhar (FZK)

* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.

DISTRICT WATER TESTING LABORATORY, FAZILKA

Village Panchawali, Fazilka
dwtifazilka@gmail.com



TEST REPORT

Name & Address of Customer : Akal Academy Theh Kalander (Fazilka) Fazilka			Customer Reference No.		No : 01 Dated : 24/03/2026	
			Sample Submitted by		9875987474	
			Date of Sample Receipt		30/03/2026	
			Analysis Starting Date		30/03/2026	
			Analysis completion Date		01/04/2026	
Discipline : Chemical Testing			Group: Water			
ULR No.:		TC140632600000102F		Sample Type :		Water
Test Report No.:		DWTL/FZK/2526/00409		Date of Issue :		01/04/2026
Registration no.:		DWTL/FZK/REG2526/02959		Condition of Sample :		Unsealed
Collection Point:		Treatment Plant (RO/CWPP/ARP/HH Purifier)		Quantity/Type of Bottle:		1000 ml / Plastic Bottles
Scheme/Source:		Not Mentioned(Not Mentioned)		Location/Depth :		Akal Academy Theh Kalander Fazilka(RO Treated Water) / NA
Village :		Not Mentioned		Habitation :		Not Mentioned
Block:		Fazilka		District :		Fazilka
Latitude :		Not Mentioned		Longitude:		Not Mentioned
Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.19@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	<5	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	169	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	T. Alkalinity(CaCO3)	56	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	T. Hardness(CaCO3)	48	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	4	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	9	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	46	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
5. * Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By



Sushma

Ms.Sushma bala
Chemist/Analyst
Authorized Signatory
For, District water Testing Laboratory
Fazilka

Manager
Akal Academy
Theh Kalander (FZK)

End of the Test Report

REGIONAL WATER TESTING LAB, AMRITSAR
New Golden Avenue, Opposite Dhobi Ghat, Near Jaura Phatak, Amritsar.
rwtlasr1@gmail.com

TEST REPORT						
Name & Address of Customer : Principal Akal Academy Theh Kalandher Village Theh Kalandher, P.O Behak Khas, Fazilka			Customer Reference No.		No : 06 Dated : 30/04/2026	
			Sample Submitted by		Mr. Sukhjinder Singh	
			Date of Sample Receipt		04/05/2026	
			Analysis Starting Date		04/05/2026	
			Analysis completion Date		04/05/2026	
Discipline : Chemical Testing			Group: Water			
ULR No.:			Sample Type :		Treated Water	
Test Report No.:		RWTLASR/2627/00149	Date of Issue :		04/05/2026	
Registration no.:		RWTLASR/REG2627/00558	Condition of Sample :		Unsealed	
Collection Point:		Treatment Plant (RO/CWPP/ARP/HH Purifier)	Quantity/Type of Bottle:		1000 ml / Plastic Bottles	
Scheme/Source:		Not Mentioned(Not Mentioned)	Location/Depth :		Source(RO), Sample Collected By Raj Kumar JE (7696891614) / NA	
Village :		Not Mentioned	Habitation :		Not Mentioned	
Block:		Not Mentioned	District :		Fazilka	
Latitude :		30.14699	Longitude:		74.109398	
Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	Aluminium(Al)	BDL(0.010)	0.03	0.2	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
2	Lead	BDL(0.005)	0.01	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
3	Selenium	BDL(0.005)	0.01	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
4	Chromium(Cr)	BDL(0.005)	0.05	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
5	Mercury	BDL(0.0005)	0.001	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
6	Arsenic(As)	BDL(0.005)	0.01	No relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
7	Cadmium(Cd)	BDL(0.001)	0.003	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
8	Nickel	BDL(0.005)	0.02	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
9	Iron(Fe)	BDL(0.005)	1	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
10	Copper(Cu)	BDL(0.010)	0.05	1.5	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
11	Uranium	BDL(5)	30	No Relaxation	µg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
12	Manganese(Mn)	BDL(0.005)	0.1	0.3	mg/l	APHA (24th Ed. 2023) Method :3125 B By ICPMS
13	Zinc(Zn)	BDL(0.01)	5	15	mg/l	APHA (24th Ed. 2023) Method: 3125 B By ICPMS

Continue on next page...

Reviewed and Approved By


Mr. Pardeep kumar
Quality Manager
Authorized Signatory
For, Regional Water Testing Lab
Amritsar



Manager
Akal Academy
Theh Kalandher (FZK)

REGIONAL WATER TESTING LAB, AMRITSAR
New Golden Avenue, Opposite Dhobi Ghat, Near Jaura Phatak, Amritsar.
rwtlasr1@gmail.com

14	Barium	0.010	0.7	No Relaxation	mg/l	APHA (24th Ed.2023) Method: 3125 B By ICPMS
----	--------	-------	-----	---------------	------	---

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
5. * Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By



Mr. Pardeep kumar
Quality Manager
Authorized Signatory
For,Regional Water Testing Lab
Amritsar

----- End of the Test Report -----



Manager
Akal Academy
Theh Kalander (FZK)